


ABSO

ASP Type

Major Applications

Fluid Clarification for foods and beverages

Beer, Wine, Distilled spirits,
Japanese Sake, Tea-based beverages,
Syrup, Flavor and Fragrance

Quality standards

- Adaptable Food Sanitation Standard
 - FDA 21 CFR
- Traceability by lot number

Features

- Cellulose depth media filled with perlite
- Wide filtration area

Advantages

- Efficiently remove bacteria and colloidal substances
- Long service life in fluid with high turbidity
- Eliminate the trouble of pre-coating filter aids and cleaning in the opposite direction.
- Could handle high flow rate and large throughput.


Specifications

Grades		10	30	50	60
Materials	E.F.A.	1.58m ²			
	Media	Cellulose, Perlite			
	Core	Polypropylene			
	Spacer / Ring	Polypropylene			
Maximum ΔP		0.49MPa at 20°C (71psi at 68°F)			
Maximum Operating Temp		80°C (176°F)			
Dimensions	Length	275.0mm			
	O.D.	284.0mm			
	I.D.	51.0mm			

*If you need further information on specifications (length, end cap type, etc.), please contact us.

Differential Pressure vs Flow Rate

Fluid: Refined Water 20°C (68°F) / Cartridge Length: 16Cells

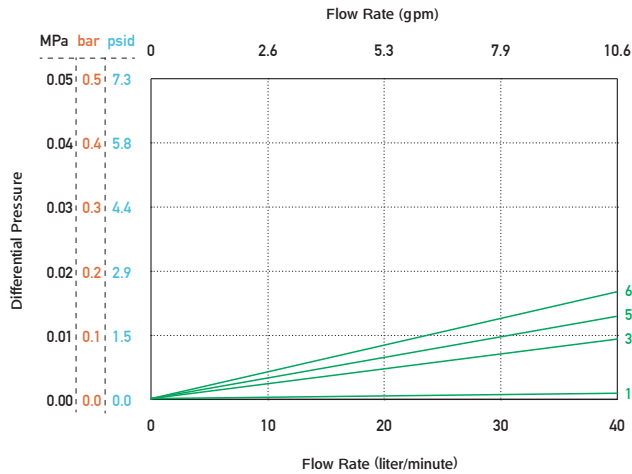

Microbial removal performance

Grades	Biological Indicator	LRV*
30	<i>Lactobacillus brevis</i>	5
50	<i>Lactobacillus brevis</i>	>6
60	<i>Lactobacillus brevis</i>	>6

*LRV represents Log Reduction Value (Refer to JIS K3835)

*Bacterial challenge level is more than 1×10^6 CFU/cm².

Particle Removal Efficiency

Grades	Particle Removal Efficiency (%)			
	10	30	50	60
0.5				>98
0.8			>98	>99.9
1.0		>98	>99.9	
2.0		>99.9		
3.0				
5.0	>98			
10	>99.9			


Test Conditions

Equipment : Liquid Particle Counter
 Filtration : Single Pass
 Fluid : Refined Water
 Flow Rate : 43.5 liter/minute (per m²)
 Dust : ALUMINA+BOEHMITE (ASP-60~30) ,
 ACFTD+LATEX Beads (ASP-10)

Ordering Information

Numbers of Cells	Product Type	Grades	Gasket
16C ▼ 16 Cells	-ASP-	50 ▼ 10 30 50 60	S ▼ Silicone

Materials of Construction

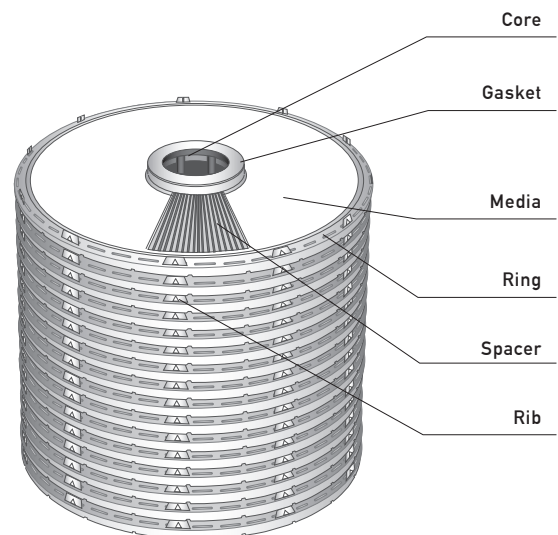

*The contents of the catalog are subject to change without notice.

*The performance data listed in the catalog are Typical values obtained under specific conditions based on our tests.

ROKI GROUP International Pte. Ltd.

6-20-12, Minami-Oi, Shinagawa-ku Tokyo, 140-0013 Japan
 TEL: +81-3-5764-1131 FAX: +81-3-5764-0681

www.rokiglobal.com

Manufacturing is based on our Quality Management Systems that meet ISO9001 standards.

Scope

Design, Development, manufacture, and sales of filter cartridges, housings and filtration equipment.



JQA-QMA16323

MS CM009

19th Issue
 ASP210329LE